


NEMA FB 2.10-2012

---

Selection and Installation  
Guidelines - Fittings for  
Use with Non-Flexible  
Metallic Conduit or  
Tubing (Rigid Metal  
Conduit, Intermediate  
Metal Conduit and  
Electrical Metallic  
Tubing)

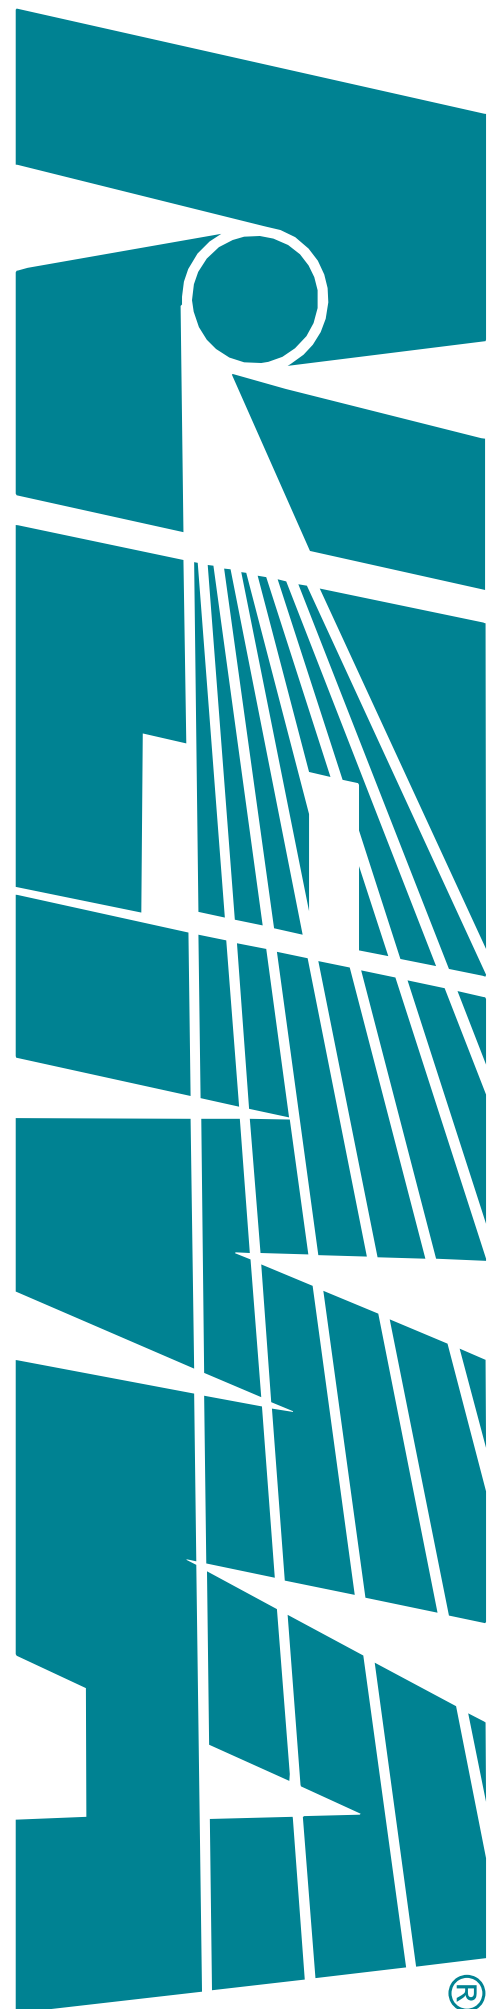

**NEMA Standards Publication FB 2.10-2012**

*Selection and Installation Guidelines  
Fittings for Use With Non-Flexible Metallic Conduit or Tubing  
(Rigid Metal Conduit, Intermediate Metal Conduit,  
and Electrical Metallic Tubing)*

*Published by:*

**National Electrical Manufacturers Association**

1300 North 17th Street, Suite 1752  
Rosslyn, VA 22209

[www.nema.org](http://www.nema.org)

© Copyright 2012 by the National Electrical Manufacturers Association. All rights including translation into other languages, reserved under the Universal copyright Convention, the Berne Convention for the Protection of Literary and Artistic Works, and the International and Pan American Copyright Conventions.

## **NOTICE AND DISCLAIMER**

The information in this publication was considered technically sound by the consensus of persons engaged in the development and approval of the document at the time it was developed. Consensus does not necessarily mean that there is unanimous agreement among every person participating in the development of this document.

The National Electrical Manufacturers Association (NEMA) standards and guideline publications, of which the document contained herein is one, are developed through a voluntary consensus standards development process. This process brings together volunteers and/or seeks out the views of persons who have an interest in the topic covered by this publication. While NEMA administers the process and establishes rules to promote fairness in the development of consensus, it does not write the document and it does not independently test, evaluate, or verify the accuracy or completeness of any information or the soundness of any judgments contained in its standards and guideline publications.

NEMA disclaims liability for any personal injury, property, or other damages of any nature whatsoever, whether special, indirect, consequential, or compensatory, directly or indirectly resulting from the publication, use of, application, or reliance on this document. NEMA disclaims and makes no guaranty or warranty, expressed or implied, as to the accuracy or completeness of any information published herein, and disclaims and makes no warranty that the information in this document will fulfill any of your particular purposes or needs. NEMA does not undertake to guarantee the performance of any individual manufacturer or seller's products or services by virtue of this standard or guide.

In publishing and making this document available, NEMA is not undertaking to render professional or other services for or on behalf of any person or entity, nor is NEMA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances. Information and other standards on the topic covered by this publication may be available from other sources, which the user may wish to consult for additional views or information not covered by this publication.

NEMA has no power, nor does it undertake to police or enforce compliance with the contents of this document. NEMA does not certify, test, or inspect products, designs, or installations for safety or health purposes. Any certification or other statement of compliance with any health or safety-related information in this document shall not be attributable to NEMA and is solely the responsibility of the certifier or maker of the statement.

## CONTENTS

	Page
<b>Foreword</b> .....	iii
<b>Introduction</b> .....	iv
<b>Product Standards and Installation Codes</b> .....	v
<b>Section 1 FITTINGS FOR USE WITH ELECTRICAL METALLIC TUBING (EMT)</b>	
<b>1.1 Fitting Selection</b> .....	1
1.1.1 Fittings for EMT for Use in Wet Locations .....	2
1.1.2 Concrete-Tight Type Fittings for EMT .....	2
1.1.3 Expansion Fittings.....	2
<b>1.2 Required Marking</b> .....	2
1.2.1 EMT Size and Material Type .....	3
1.2.2 Application Environment .....	3
<b>1.3 Grounding</b> .....	3
<b>1.4 Raceway Preparation and Fitting Assembly Technique</b> .....	4
1.4.1 Tightening Torque.....	4
1.4.2 Concrete-Tight Type Fittings .....	5
<b>1.5 Attachment to Boxes and Support</b> .....	5
1.5.1 Attachment to Threaded Entries.....	6
<b>1.6 Verification of Installation</b> .....	6
<b>Section 2 FITTINGS FOR USE WITH RIGID METAL CONDUIT AND INTERMEDIATE METAL CONDUIT</b>	
<b>2.1 Fitting Selection</b> .....	10
2.1.1 Fittings for Rigid and Intermediate Metal Conduit for Use in Wet Locations.....	11
2.1.2 Concrete-Tight Type Fittings for Rigid Metal Conduit and Intermediate Metal Conduit..	12
2.1.3 Expansion Fittings.....	12
2.1.4 Conduit Bodies .....	12
<b>2.2 Required Marking</b> .....	12
2.2.1 Conduit Size and Material Type.....	12

2.2.2	Application Environment .....	13
<b>2.3</b>	<b>Grounding.....</b>	<b>13</b>
<b>2.4</b>	<b>Raceway Preparation and Fitting Assembly Technique.....</b>	<b>14</b>
2.4.1	Threadless Fittings.....	14
2.4.2	Tightening Torque.....	14
2.4.3	Concrete-Tight Type Fittings .....	15
2.4.4	Threaded Fittings for Threaded Conduit .....	15
<b>2.5</b>	<b>Attachment to Boxes and Support.....</b>	<b>15</b>
<b>2.6</b>	<b>Attachment to Threaded Entries.....</b>	<b>16</b>
<b>2.7</b>	<b>Verification of Installation .....</b>	<b>16</b>

**TABLES**

<b>Table 1-1</b>	<b>TRADE SIZES AND METRIC DESIGNATORS FOR EMT .....</b>	<b>6</b>
<b>Table 1-2</b>	<b>TIGHTENING TORQUE OF EMT FITTINGS.....</b>	<b>7</b>
<b>Table 2-1</b>	<b>TRADE SIZES AND METRIC DESIGNATORS FOR RIGID METAL CONDUIT AND IMC ...</b>	<b>18</b>
<b>Table 2-2</b>	<b>TIGHTENING TORQUE FOR RMC AND IMC FITTINGS .....</b>	<b>18</b>

**FIGURES**

<b>Figure 1-1</b>	<b>TYPICAL ELECTRICAL METALLIC TUBING FITTING DESIGNS .....</b>	<b>8</b>
<b>Figure 1-2</b>	<b>TYPICAL SUPPORTS FOR EMT .....</b>	<b>9</b>
<b>Figure 2-1</b>	<b>TYPICAL RMC AND IMC FITTING DESIGNS .....</b>	<b>19</b>
<b>Figure 2-2</b>	<b>TYPICAL THREADED CONDUIT ENTRIES .....</b>	<b>21</b>
<b>Figure 2-3</b>	<b>TYPICAL SUPPORTS FOR RMC AND IMC .....</b>	<b>22</b>
<b>Appendix A</b>	<b>Conduit Body Conductor Fill .....</b>	<b>A-1</b>

## Foreword

These selection and installation guidelines offer practical information on correct product selection and industry recommended practices for the installation of fittings for nonflexible metallic conduit or tubing in accordance with the National Electrical Code®.

These guidelines have been developed by the NEMA Conduit Fittings Section, which periodically reviews them for any revisions necessary to address changing conditions, product listing and installation requirements, and technical progress. Comments for proposed revisions are welcomed and should be submitted to:

Vice President, Technical Services  
National Electrical Manufacturers Association  
1300 North 17th Street, Suite 1752  
Rosslyn, VA 22209

At the time of approval, the Conduit Fittings Section of the National Electrical Manufacturers Association had the following members:

Adalet—Cleveland, OH  
AFC Cable Systems, Part of Atkore International—New Bedford, MA  
Arlington Industries, Inc.—Scranton, PA  
Bridgeport Fittings, Inc.—Bridgeport, CT  
Cooper B-Line—Highland, IL  
Cooper Crouse-Hinds—Syracuse, NY  
EGS Electrical Group—Rosemont, IL  
Erico, Inc.—Solon, OH  
Hubbell Incorporated—Shelton, CT  
IPEX USA LLC—Mississauga, ON Canada  
Killark Electric Manufacturing Company—St. Louis, MO  
Pass & Seymour/Legrand—Syracuse, NY  
Plastic Trends, Inc.—Shelby Township, MI  
Producto Electric Corporation—Orangeburg, NY  
Progressive Machine Die, Inc.—Walton Hills, OH  
RACO, Hubbell Incorporated—South Bend, IN

Sigma Electric Manufacturing Corporation—Garner, NC  
Steel Electric Products Company, Inc.—Brooklyn, NY  
Thomas & Betts Corporation—Memphis, TN

## Introduction

It is a common perception that in any continuous system the joints (splices, taps, couplings, connections) are the weakest link. In fact specifically by design, this is not usually the case. In order to achieve this design performance, variables such as *selection*; *preparation*; and *assembly technique* must be considered. We know it is not practical to have a system without joints, so we strive to build in safety where these occur.

The expectations and demands on our electrical raceway systems have continued to evolve. Many metallic conduit raceway systems (conduit, fittings, and enclosures) are relied upon both to provide mechanical protection for circuit conductors and to carry potentially dangerous fault currents. Flexible metallic and nonmetallic conduit and metallic and composite cable systems have been introduced to meet ever-changing market needs. Emerging manufacturing technology and economic pressures have resulted in noticeable changes to some system components. Because of this evolution, sole reliance on the historical mechanical evaluation criteria of the system's components is of increasing concern to those charged with approving an installation. These concerns are very often evidenced through product standards development and installation code processes.

Along with evolving manufacturing technology, improved and new materials and processes are used in the manufacture of conduit fittings. Considering the variety of materials: steel; iron; aluminum; zinc; and engineered plastics, the industry has come a long way in providing numerous options to solve an infinite number of applications. Through the years NEMA member companies who manufacture conduit fittings have met the needs of the market with new and innovative product designs that continue to live up to higher standards demanded by the market.

These guidelines are written by the NEMA Conduit Fittings Section (5-FB) to provide installers and inspectors with an industry perspective of best practices in selecting and installing the products we manufacture. Focus is placed on important fundamentals and recent changes to codes, product standards and latest technologies. The member companies of the NEMA Conduit Fittings Section promote the selection and installation of listed conduit and cable fittings, listed conduit and cable, and associated supports. Listing electrical system components qualifies them for minimum performance requirements and provides for ongoing conformity surveillance. Listed conduit fittings can be recognized by the trademark of the qualified electrical testing laboratory on the part or its smallest unit container.

It is our objective to maintain a closer liaison with the installers of our products and the professional electrical inspector. Through this liaison, we intend to provide uniform education and understanding as to the intended use and application of our products and develop an alliance founded in trust, that will enable us together to address and resolve the concerns and challenges we each face. Thousands of downloads of earlier editions of this document and its regular use as a reference in codes and standards forums gives us confidence that we are meeting this objective. This and other valuable NEMA documents are available for downloading free of charge at [www.nema.org](http://www.nema.org).

*Note:* All references to the National Electrical Code® are to the 2011 Edition.