


Ground motion determination for seismic qualification of nuclear power plants

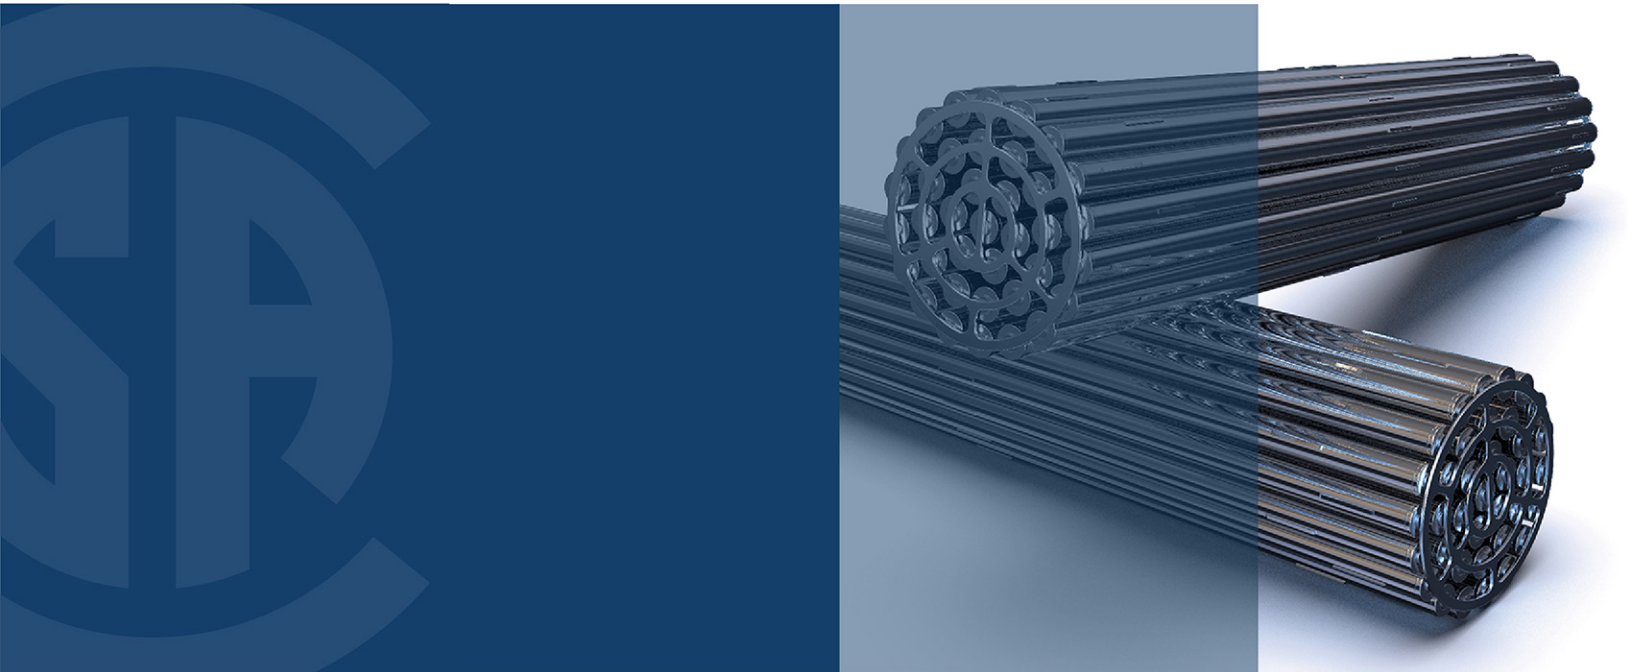

Legal Notice for Standards

Canadian Standards Association (operating as “CSA Group”) develops standards through a consensus standards development process approved by the Standards Council of Canada. This process brings together volunteers representing varied viewpoints and interests to achieve consensus and develop a standard. Although CSA Group administers the process and establishes rules to promote fairness in achieving consensus, it does not independently test, evaluate, or verify the content of standards.

Disclaimer and exclusion of liability

This document is provided without any representations, warranties, or conditions of any kind, express or implied, including, without limitation, implied warranties or conditions concerning this document’s fitness for a particular purpose or use, its merchantability, or its non-infringement of any third party’s intellectual property rights. CSA Group does not warrant the accuracy, completeness, or currency of any of the information published in this document. CSA Group makes no representations or warranties regarding this document’s compliance with any applicable statute, rule, or regulation.

IN NO EVENT SHALL CSA GROUP, ITS VOLUNTEERS, MEMBERS, SUBSIDIARIES, OR AFFILIATED COMPANIES, OR THEIR EMPLOYEES, DIRECTORS, OR OFFICERS, BE LIABLE FOR ANY DIRECT, INDIRECT, OR INCIDENTAL DAMAGES, INJURY, LOSS, COSTS, OR EXPENSES, HOWSOEVER CAUSED, INCLUDING BUT NOT LIMITED TO SPECIAL OR CONSEQUENTIAL DAMAGES, LOST REVENUE, BUSINESS INTERRUPTION, LOST OR DAMAGED DATA, OR ANY OTHER COMMERCIAL OR ECONOMIC LOSS, WHETHER BASED IN CONTRACT, TORT (INCLUDING NEGLIGENCE), OR ANY OTHER THEORY OF LIABILITY, ARISING OUT OF OR RESULTING FROM ACCESS TO OR POSSESSION OR USE OF THIS DOCUMENT, EVEN IF CSA GROUP HAS BEEN ADVISED OF THE POSSIBILITY OF SUCH DAMAGES, INJURY, LOSS, COSTS, OR EXPENSES.

In publishing and making this document available, CSA Group is not undertaking to render professional or other services for or on behalf of any person or entity or to perform any duty owed by any person or entity to another person or entity. The information in this document is directed to those who have the appropriate degree of experience to use and apply its contents, and CSA Group accepts no responsibility whatsoever arising in any way from any and all use of or reliance on the information contained in this document.

CSA Group is a private not-for-profit company that publishes voluntary standards and related documents. CSA Group has no power, nor does it undertake, to enforce compliance with the contents of the standards or other documents it publishes.

Intellectual property rights and ownership

As between CSA Group and the users of this document (whether it be in printed or electronic form), CSA Group is the owner, or the authorized licensee, of all works contained herein that are protected by copyright, all trade-marks (except as otherwise noted to the contrary), and all inventions and trade secrets that may be contained in this document, whether or not such inventions and trade secrets are protected by patents and applications for patents. Without limitation, the unauthorized use, modification, copying, or disclosure of this document may violate laws that protect CSA Group’s and/or others’ intellectual property and may give rise to a right in CSA Group and/or others to seek legal redress for such use, modification, copying, or disclosure. To the extent permitted by licence or by law, CSA Group reserves all intellectual property rights in this document.

Patent rights

Attention is drawn to the possibility that some of the elements of this standard may be the subject of patent rights. CSA Group shall not be held responsible for identifying any or all such patent rights. Users of this standard are expressly advised that determination of the validity of any such patent rights is entirely their own responsibility.

Authorized use of this document

This document is being provided by CSA Group for informational and non-commercial use only. The user of this document is authorized to do only the following:

If this document is in electronic form:

- load this document onto a computer for the sole purpose of reviewing it;
- search and browse this document; and
- print this document if it is in PDF format.

Limited copies of this document in print or paper form may be distributed only to persons who are authorized by CSA Group to have such copies, and only if this Legal Notice appears on each such copy.

In addition, users may not and may not permit others to

- alter this document in any way or remove this Legal Notice from the attached standard;
- sell this document without authorization from CSA Group; or
- make an electronic copy of this document.

If you do not agree with any of the terms and conditions contained in this Legal Notice, you may not load or use this document or make any copies of the contents hereof, and if you do make such copies, you are required to destroy them immediately. Use of this document constitutes your acceptance of the terms and conditions of this Legal Notice.



Standards Update Service

CSA N289.2:21

January 2021

Title: *Ground motion determination for seismic qualification of nuclear power plants*

To register for e-mail notification about any updates to this publication

- go to store.csagroup.org
- click on **Product Updates**

The **List ID** that you will need to register for updates to this publication is **2428590**.

If you require assistance, please e-mail techsupport@csagroup.org or call 416-747-2233.

Visit CSA Group's policy on privacy at www.csagroup.org/legal to find out how we protect your personal information.

CSA N289.2:21
***Ground motion determination for
seismic qualification of nuclear
power plants***



®A trademark of the Canadian Standards Association, operating as "CSA Group"

*Published in January 2021 by CSA Group
A not-for-profit private sector organization
178 Rexdale Boulevard, Toronto, Ontario, Canada M9W 1R3*

*To purchase standards and related publications, visit our Online Store at store.csagroup.org
or call toll-free 1-800-463-6727 or 416-747-4044.*

ISBN 978-1-4883-3551-8

*© 2021 Canadian Standards Association
All rights reserved. No part of this publication may be reproduced in any form whatsoever
without the prior permission of the publisher.*

Contents

Technical Committee on Seismic Design for Nuclear Power Plants	3
Subcommittee on Ground Motion Determination for Seismic Qualification of Nuclear Power Plants	6
Preface	7
0 Introduction	9
1 Scope	9
2 Reference publications	10
3 Definitions and abbreviations	19
3.1 Definitions	19
3.2 Abbreviations	21
4 Site, site vicinity, and regional investigations	22
4.1 General	22
4.2 Seismological investigations	22
4.2.1 Historical seismicity	22
4.2.2 Site vicinity microearthquake monitoring	24
4.2.3 Regional seismic source and propagation properties	24
4.3 Geological investigations	25
4.3.1 General	25
4.3.2 Regional geology	25
4.3.3 Site vicinity and site geology	26
4.4 Investigations of secondary earthquake effects	27
4.4.1 General	27
4.4.2 Phenomena requiring investigation	28
5 Development of seismic hazard models	31
5.1 General	31
5.2 Seismic source characterization	31
5.2.1 General	31
5.2.2 Spatial distribution of earthquakes	32
5.2.3 Earthquake recurrence model(s)	33
5.2.4 Other characteristics of earthquakes	34
5.3 Ground motion models (GMMs)	35
5.3.1 General	35
5.3.2 Applicability	36
5.3.3 Uncertainty in GMMs	37
5.4 Model weights	37
6 Evaluation of seismic hazard for the reference site condition	38
6.1 General	38
6.2 Reference site conditions	38
6.3 Probabilistic seismic hazard assessment	39

6.4	Seismic hazard results	40
6.4.1	General	40
6.4.2	Near-fault sites	40
6.4.3	Damage potential of earthquakes	40
6.5	Uncertainty in hazard results	41
6.6	Development of scenario earthquakes	42
7	Evaluation of seismic hazard considering local site conditions	42
7.1	General	42
7.2	Site response analysis procedure	43
7.3	Input motions at the reference site conditions	43
7.3.1	Input from PSHA	43
7.3.2	Characteristics of ground motion as input to site response	43
7.4	Geotechnical model for the site	44
7.4.1	General	44
7.4.2	Geotechnical properties of soil or rock materials	45
7.4.3	Variability in geotechnical properties	45
7.5	Evaluation of site responses	45
7.6	Seismic hazard considering local site conditions	46
7.7	Uncertainty in site response	47
8	Independent peer review	47
9	Documentation and records	48
9.1	Documentation	48
9.2	Records	48

Annex A (informative)	— Assessment of seismological and geological information	50
Annex B (informative)	— Processing of earthquake motions recorded at plant site	54
Annex C (informative)	— Bibliography	55

Preface

This is the third edition of CSA N289.2, *Ground motion determination for seismic qualification of nuclear power plants*. It supersedes the previous editions, published in 2010 and 1981.

The major changes to this edition include the following:

- Clause [4](#) has been revised to address microearthquake monitoring and induced seismicity.
- Clause [5](#) has been revised and restructured to provide more details on and differentiate between seismic source characterization and ground motion models (GMMs), and to address the weights associated with both.
- Clause [6](#) has been revised to address seismic hazard results for near-fault sites, while considering damage potential of earthquakes, and the development of scenario earthquakes.
- A new Clause [7](#), on evaluation of seismic hazards considering local site conditions, has been introduced to provide a procedure to account for local conditions and for various sources of uncertainty.
- A new Clause [8](#), an independent peer review, has been introduced to enhance the confidence level of seismic hazard assessment and evaluations.
- A new informative annex (Annex [B](#)) has been introduced for processing earthquake motions recorded at the plant site.
- Another new informative annex (Annex [C](#)), a bibliography, has been introduced to include recent references and publications associated with the scope of this Standard.
- This Standard has been aligned with recently published CSA Group standards, CNSC Regulatory Documents, and industry documents.

Standards in the CSA N289 series of Standards are developed in response to a recognition by the utilities and industries concerned with nuclear facilities in Canada of a need for the documentation of standards applicable to the seismic design and qualification of nuclear structures, systems, and components (SSCs) of nuclear power plants. Users of this Standard should recognize that it has the force of law only when adopted by the Canadian Nuclear Safety Commission (CNSC) or the appropriate regulatory body (in countries other than Canada).

The CSA N289 series of Standards consists of five Standards. Some of the objectives of each Standard are summarized as follows:

- a) CSA N289.1-18, *General requirements for seismic design and qualification of nuclear power plants*, provides guidelines for identifying structures and systems requiring seismic qualification based on nuclear safety considerations;
- b) CSA N289.2:21, *Ground motion determination for seismic qualification of nuclear power plants*, determines the appropriate seismic ground motion parameters for a particular site;
- c) CSA N289.3:20, *Design procedures for seismic qualification of nuclear power plants*, provides design requirements, criteria, and methods of analysis for
 - i) determining the design response spectra and ground motion time-histories to be used in the analysis;
 - ii) establishing design criteria for SSCs, and supports that require seismic qualification; and
 - iii) performing seismic analyses, including the effects of the soil-structure interaction;
- d) CSA N289.4-12, *Testing procedures for seismic qualification of nuclear power plant structures, systems and components*, provides design requirements and methods for seismic qualification of specific components and systems by testing methods; and

- e) CSA N289.5-12, *Seismic instrumentation requirements for nuclear power plants and nuclear facilities*, establishes the requirements for seismic instrumentation and for seismic-related inspection of structures and systems before and after a seismic event.

The CSA N-Series Standards provide an interlinked set of requirements for the management of nuclear facilities and activities. CSA N286 provides overall direction to management to develop and implement sound management practices and controls, while the other CSA Group nuclear Standards provide technical requirements and guidance that support the management system. This Standard works in harmony with CSA N286 and does not duplicate the generic requirements of CSA N286; however, it can provide more specific direction for those requirements.

Users of this Standard are reminded that the design, manufacture, construction, commissioning, operation, and decommissioning of nuclear facilities in Canada are subject to the provisions of the *Nuclear Safety and Control Act* and its Regulations. The Canadian Nuclear Safety Commission (CNSC) can therefore impose additional requirements to those specified in this Standard.

This Standard was prepared by the Subcommittee on Ground Motion Determination for Seismic Qualification of Nuclear Power Plants, under the jurisdiction of the Technical Committee on Seismic Design for Nuclear Power Plants and the Strategic Steering Committee on Nuclear Standards, and has been formally approved by the Technical Committee.

Notes:

- 1) *Use of the singular does not exclude the plural (and vice versa) when the sense allows.*
- 2) *Although the intended primary application of this Standard is stated in its Scope, it is important to note that it remains the responsibility of the users of the Standard to judge its suitability for their particular purpose.*
- 3) *This Standard was developed by consensus, which is defined by CSA Policy governing standardization — Code of good practice for standardization as “substantial agreement. Consensus implies much more than a simple majority, but not necessarily unanimity”. It is consistent with this definition that a member may be included in the Technical Committee list and yet not be in full agreement with all clauses of this Standard.*
- 4) *To submit a request for interpretation of this Standard, please send the following information to inquiries@csagroup.org and include “Request for interpretation” in the subject line:*
 - a) *define the problem, making reference to the specific clause, and, where appropriate, include an illustrative sketch;*
 - b) *provide an explanation of circumstances surrounding the actual field condition; and*
 - c) *where possible, phrase the request in such a way that a specific “yes” or “no” answer will address the issue.*

Committee interpretations are processed in accordance with the CSA Directives and guidelines governing standardization and are available on the Current Standards Activities page at standardsactivities.csa.ca.
- 5) *This Standard is subject to review within five years from the date of publication. Suggestions for its improvement will be referred to the appropriate committee. To submit a proposal for change, please send the following information to inquiries@csagroup.org and include “Proposal for change” in the subject line:*
 - a) *Standard designation (number);*
 - b) *relevant clause, table, and/or figure number;*
 - c) *wording of the proposed change; and*
 - d) *rationale for the change.*

CSA N289.2:21

Ground motion determination for seismic qualification of nuclear power plants

0 Introduction

Determination of ground shaking hazard involves the following:

- a) geological and seismological investigations performed for site, site vicinity, and region including investigation for secondary earthquake effects;
- b) development of seismic hazard models including source characterization;
- c) probabilistic evaluation of seismic hazard on reference site condition; and
- d) probabilistic evaluation of seismic hazard considering local site conditions.

Uncertainties associated with parameters defining seismic sources and those defining the hazard are typically accounted for.

Note: Figure 1 is a flowchart outlining the ground motion determination process.

1 Scope

1.1

This Standard describes the investigations required to obtain the seismological and geological information necessary to determine the seismic ground motion that will be used in seismic qualification of safety-related nuclear power plant structures, systems, and components (SSCs), and the potential for secondary earthquake effects (e.g., tsunami, seiche, volcanism, slope instability, surface faults, surface instability, and dam failures) that can have a direct or indirect effect on plant safety or operation.

Notes:

- 1) *This Standard establishes the basis for a family of seismic hazard results that can be used as input to CSA N289 Series of Standards. This Standard does not specify*
 - a) *ground motion parameters to be used in design;*
 - b) *probability level; or*
 - c) *degree of confidence to be achieved.*
- 2) *The investigations specified in this Standard should be updated periodically to reflect gained knowledge and modern requirements. The investigations may be conducted independently or as part of the periodic safety review (refer to REGDOC-2.3.3, CSA N289.1, and CSA N290.18).*

1.2

This Standard was developed for the determination of ground motions for Eastern North American regions of low to moderate seismic hazard, comparable to the levels near Canada's existing nuclear power plants. In regions of higher seismic hazard, the assessment of strong earthquake shaking can be more complex due to near-fault and other effects that are beyond the scope of this Standard.

Therefore, while the provisions of this Standard can be applied to any nuclear power plant site, additional provisions might be required for high seismic hazard sites.

Note: *Guidance regarding additional provisions for high seismic hazard sites may be obtained from IAEA Specific Safety Guide SSG-9, and relevant codes of other countries.*