

Date of Issue: August 17, 1998

Affected Publication: API Recommended Practice 500, *Recommended Practice for Classification of Locations for Electrical Installations at Petroleum Facilities Classified as Class I, Division 1 and Division 2*, 2nd Edition, November 1997


ERRATA

The following figures are replaced by the next three pages:

Page 79, Figure 90

Page 80, Figure 91 and


Page 81, Figure 92.

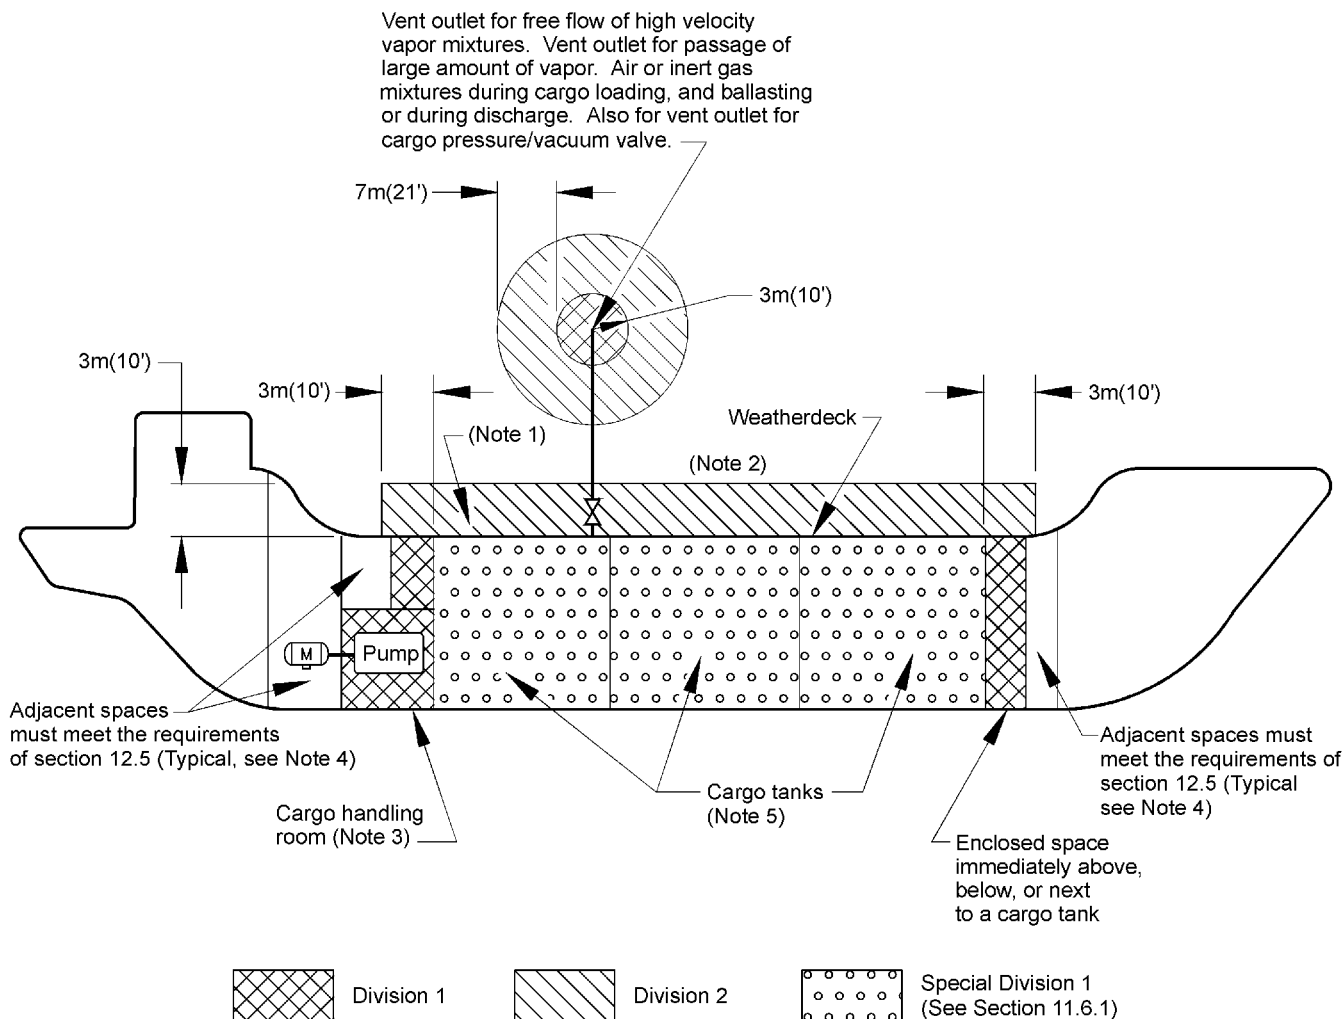

Notes:

1. This area classified due to proximity to cargo tanks.
2. Areas more than 3m(10') above the weatherdeck are unclassified except as required by this document for production equipment contained therein.
3. Space must be:
 - a) continuously ventilated at ≥ 20 air changes per hour, and
 - b) loss of ventilation must be alarmed in a manned space, and
 - c) combustible gas detection must be installed in accordance with section 6.5.2 .
 or, If ventilated < 20 air changes per hour, loss of ventilation is not alarmed, or gas detectors are not installed, then the space is classified a special Division 1 location.
4. All spaces are subject to the adjacent space requirements of section 12.5.
5. Cargo is defined as a flammable gas or vapor or flammable or combustible liquid with a flashpoint below 60°C (140°F)


Figure 90—Typical Floating Production Storage and Offloading Unit (FPSO)
(See Section 12.2.1)

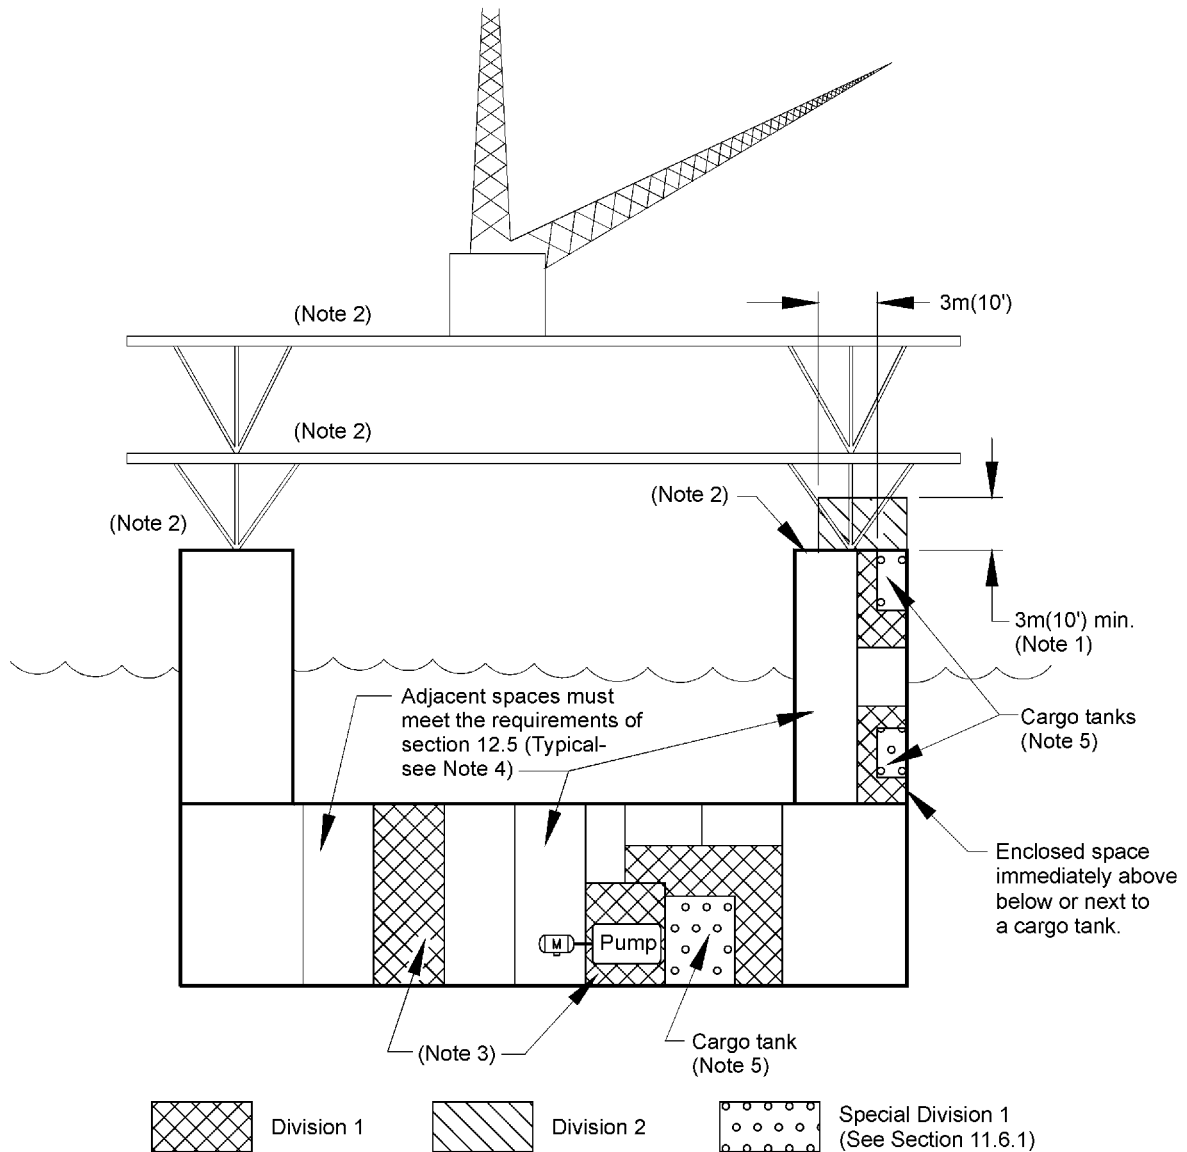

Notes:

1. This area classified due to proximity to cargo tanks.
2. Areas more than 3m(10') above the weatherdeck are unclassified except as required by this document for production and drilling equipment contained therein.
3. Space containing processing equipment or natural gas fueled prime mover with all flammable liquid or gas vents extended to the outside of the area are classified Division 1 if:
 - a) continuously ventilated at ≥ 20 air changes per hour, and
 - b) loss of ventilation must be alarmed in a manned space, and
 - c) combustible gas detection must be installed in accordance with section 6.5.2 .
 or, If ventilated < 20 air changes per hour, loss of ventilation is not alarmed, or gas detectors are not installed, then the space is classified a Special Division 1 location.
4. All spaces are subject to the adjacent space requirements of section 12.5.
5. Cargo is defined as a flammable gas or vapor or flammable or combustible liquid with a flashpoint below 60°C(140°F)

Figure 91—Typical Tension Leg Platform (TLP)
(See Section 12.3.1)

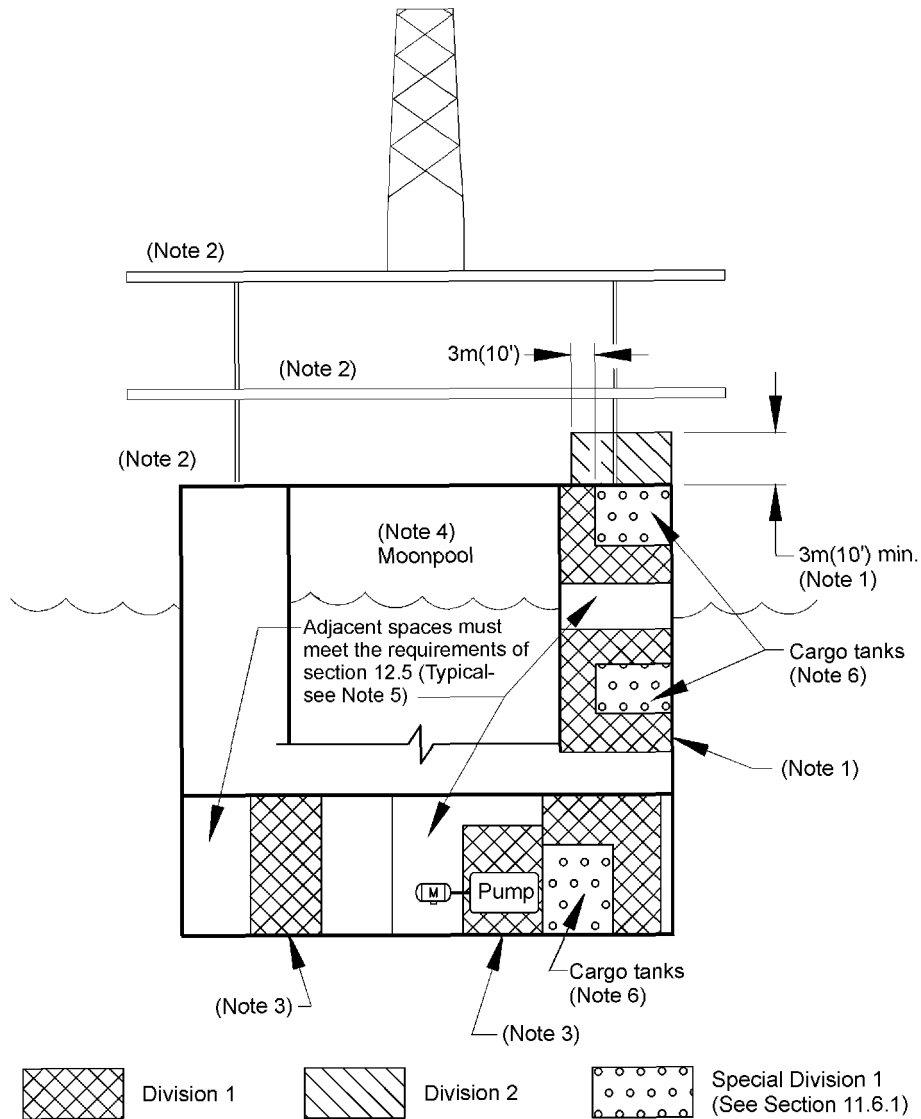

Notes:

1. This area classified due to proximity to cargo tanks.
2. Areas more than 3m(10') above the weatherdeck are unclassified except as required by this document for production and drilling equipment contained therein.
3. Space containing processing equipment or natural gas fueled prime mover with all flammable liquid or gas vents extended to the outside of the area are classified Division 1 if:
 - a) continuously ventilated at ≥ 20 air changes per hour, and
 - b) loss of ventilation must be alarmed in a manned space, and
 - c) combustible gas detection must be installed in accordance with section 6.5.2 .
 or, If ventilated <20 air changes per hour, loss of ventilation is not alarmed, or gas detectors are not installed, then the space is classified a Special Division 1 location.
4. Moonpool area is unclassified if it contains all welded closed piping or continuous metallic tubing systems without valves flanges or similar devices, and is not within the hazardous area created by adjacent equipment.
5. All spaces are subject to the adjacent space requirements of section 12.5.
6. Cargo is defined as a flammable gas or vapor or flammable or combustible liquid with a flashpoint below $60^{\circ}\text{C}(140^{\circ}\text{F})$

Figure 92—Typical Spar, Caisson, or Similar Unit
(See Section 12.4.1)

Recommended Practice for Classification of Locations for Electrical Installations at Petroleum Facilities Classified as Class I, Division 1 and Division 2

API RECOMMENDED PRACTICE 500
SECOND EDITION, NOVEMBER 1997

REAFFIRMED: NOVEMBER 2002



Recommended Practice for Classification of Locations for Electrical Installations at Petroleum Facilities Classified as Class I, Division 1 and Division 2

Downstream Segment

API RECOMMENDED PRACTICE 500
SECOND EDITION, NOVEMBER 1997

REAFFIRMED: NOVEMBER 2002



SPECIAL NOTES

API publications necessarily address problems of a general nature. With respect to particular circumstances, local, state, and federal laws and regulations should be reviewed.

API is not undertaking to meet the duties of employers, manufacturers, or suppliers to warn and properly train and equip their employees, and others exposed, concerning health and safety risks and precautions, nor undertaking their obligations under local, state, or federal laws.

Information concerning safety and health risks and proper precautions with respect to particular materials and conditions should be obtained from the employer, the manufacturer or supplier of that material, or the material safety data sheet.

Nothing contained in any API publication is to be construed as granting any right, by implication or otherwise, for the manufacture, sale, or use of any method, apparatus, or product covered by letters patent. Neither should anything contained in the publication be construed as insuring anyone against liability for infringement of letters patent.

Generally, API standards are reviewed and revised, reaffirmed, or withdrawn at least every five years. Sometimes a one-time extension of up to two years will be added to this review cycle. This publication will no longer be in effect five years after its publication date as an operative API standard or, where an extension has been granted, upon republication. Status of the publication can be ascertained from the API Manufacturing, Distribution and Marketing Department [telephone (202) 682-8000]. A catalog of API publications and materials is published annually and updated quarterly by API, 1220 L Street, N.W., Washington, D.C. 20005.

This document was produced under API standardization procedures that ensure appropriate notification and participation in the developmental process and is designated as an API standard. Questions concerning the interpretation of the content of this standard or comments and questions concerning the procedures under which this standard was developed should be directed in writing to the director of the Manufacturing, Distribution and Marketing Department (shown on the title page of this document), American Petroleum Institute, 1220 L Street, N.W., Washington, D.C. 20005. Requests for permission to reproduce or translate all or any part of the material published herein should also be addressed to the director.

API standards are published to facilitate the broad availability of proven, sound engineering and operating practices. These standards are not intended to obviate the need for applying sound engineering judgment regarding when and where these standards should be utilized. The formulation and publication of API standards is not intended in any way to inhibit anyone from using any other practices.

Any manufacturer marking equipment or materials in conformance with the marking requirements of an API standard is solely responsible for complying with all the applicable requirements of that standard. API does not represent, warrant, or guarantee that such products do in fact conform to the applicable API standard.

All rights reserved. No part of this work may be reproduced, stored in a retrieval system, or transmitted by any means, electronic, mechanical, photocopying, recording, or otherwise, without prior written permission from the publisher. Contact the Publisher, API Publishing Services, 1220 L Street, N.W., Washington, D.C. 20005.

FOREWORD

This Recommended Practice is under the joint jurisdiction of the API Exploration and Production (E&P) Department, Committee on Production Equipment Standards, the API Manufacturing Distribution and Marketing (MDM) Department, Committee on Refinery Equipment, and the Pipeline Operations Technical Committee. It is based upon a level of knowledge gained through experience and through the successful application of this practice in the refining, drilling and producing, and pipeline segments of the petroleum industry. The First Edition of this Recommended Practice was issued June 1, 1991 under the joint jurisdiction of the API Production, Refining and Transportation Departments.

The first edition of RP 500A was published in February 1955 as RP 500, Recommended Practice for Classification of Areas for Electrical Installations in Petroleum Refineries. The second edition was published in January 1957. The third edition was published as RP 500A in April 1966. The third edition was reaffirmed in 1973. The fourth edition was published in January 1982 as RP 500A, with a new title, Classification of Locations for Electrical Installations in Petroleum Refineries. The fourth edition was reaffirmed in December 1987.

RP 500B was originally issued January 1961 as RP 11J, Recommended Practice for Placement of Electrical Equipment on Production Leases. The first edition of RP 500B was issued in January 1966 under the title, Recommended Practice for Classification in Areas for Electrical Installations at Production Facilities. The title was changed in the second edition, July 1973, to Recommended Practice for Classification of Areas for Electrical Installations at Drilling Rigs and Production Facilities on Land and on Marine Fixed and Mobile Platforms. The third edition of RP 500B, Recommended Practice for Classification of Locations for Electrical Installations at Drilling Rigs and Production Facilities on Land and on Marine Fixed and Mobile Platforms was issued October 1, 1987.

The first edition of API RP 500C was published in September 1966, under the title Recommended Practice for Classification of Areas for Electrical Installations at Petroleum and Gas Pipeline Transportation Facilities. The first edition was re-approved in 1974. The title was changed in the second edition, July 1984, to Classification of Locations for Electrical Installations at Pipeline Transportation Facilities. The second edition was reaffirmed in March 1990.

API publications may be used by anyone desiring to do so. Every effort has been made by the Institute to assure the accuracy and reliability of the data contained in them; however, the Institute makes no representation, warranty, or guarantee in connection with this publication and hereby expressly disclaims any liability or responsibility for loss or damage resulting from its use or for the violation of any federal, state, or municipal regulation with which this publication may conflict.

Suggested revisions are invited and should be submitted to the director of the Manufacturing, Distribution and Marketing Department, American Petroleum Institute, 1220 L Street, N.W., Washington, D.C. 20005.

CONTENTS

	Page
1 SCOPE.....	1
1.1 Purpose	1
1.2 Scope.....	1
2 REFERENCES	2
2.1 Industry Codes, Guides and Standards.....	2
2.2 Government Codes, Rules, and Regulations	3
3 ACRONYMS AND ABBREVIATED DEFINITIONS	4
3.1 Acronyms	4
3.2 Definitions.....	4
4 BASIC CONDITIONS FOR A FIRE OR EXPLOSION.....	6
5 FLAMMABLE AND COMBUSTIBLE LIQUIDS, GASES AND VAPORS.....	7
5.1 General	7
5.2 Flammable and Combustible Liquids	7
5.3 Flammable Highly Volatile Liquids.....	7
5.4 Flammable Lighter-Than-Air Gases	8
5.5 National Electrical Code Grouping of Atmospheric Mixtures	8
6 CLASSIFICATION CRITERIA.....	9
6.1 General	9
6.2 National Electrical Code Criteria	9
6.3 Ventilation.....	11
6.4 Adjacent Areas	13
6.5 Use of Combustible Gas Detection Equipment.....	15
7 EXTENT OF A CLASSIFIED LOCATION	16
7.1 General	16
7.2 Outdoor Locations	16
7.3 Enclosed Locations.....	16
8 RECOMMENDATIONS FOR DETERMINING DEGREE AND EXTENT OF CLASSIFIED LOCATIONS—COMMON APPLICATIONS.....	16
8.1 General	16
8.2 Recommendations for Areas Surrounding Specific Equipment	17
9 RECOMMENDATIONS FOR DETERMINING DEGREE AND EXTENT OF CLASSIFIED LOCATIONS IN PETROLEUM REFINERIES	30
9.1 Introduction.....	30
9.2 Recommendations	31
10 RECOMMENDATIONS FOR DETERMINING DEGREE AND EXTENT OF CLASSIFIED LOCATIONS AT DRILLING RIGS AND PRODUCTION FACILITIES ON LAND AND ON MARINE FIXED PLATFORMS.....	38
10.1 General	38
10.2 Drilling Areas	38
10.3 Production Facilities.....	38

10.4	Drilling Wells	38
10.5	Producing Oil and Gas Wells	45
10.6	Oil and Gas Processing and Storage Equipment	49
10.7	Automatic Custody Transfer (ACT) Units	51
10.8	Flammable Gas-Blanketed Equipment and Produced/Processed Water Handling Equipment	51
10.9	Compressor or Pump Handling Flammable Liquids, Gases, or Vapors	52
10.10	Drip Pans	52
10.11	Instruments	53
10.12	Sumps	54
10.13	Drains	56
10.14	Reserved for Future Use	58
10.15	Screwed Connections, Flanges, Valves, and Valve Operators	58
10.16	Control Panels Containing Instrumentation Utilizing or Measuring Flammable Liquids, Gases or Vapors	59
11	RECOMMENDATIONS FOR DETERMINING DEGREE AND EXTENT OF CLASSIFIED LOCATIONS ON MOBILE OFFSHORE DRILLING UNITS (MODUS)	60
11.1	General	60
11.2	Definitions Specific to MODUS	60
11.3	Reserved for Future Use	61
11.4	Classified Locations on Mobile Offshore Drilling Units (MODUS)	61
11.5	Basis for Area Classification	62
11.6	Classification of Hazardous (Classified) Locations	62
11.7	Drill Floor and Derrick Areas	63
11.8	Substructure or Moonpool Areas	63
11.9	Mud System Processing Equipment Overview	70
11.10	Mud Tanks (After Discharge of Final Degasser)	70
11.11	Mud Ditches or Troughs	73
11.12	Mud Pumps	75
11.13	Mud Processing Equipment (Between the Bell Nipple and Mud Discharge of Final Degasser)	75
11.14	Desander or Desilter (Between Mud Discharge of Final Degasser and the Mud Pit)	76
11.15	Vents	76
11.16	Diverter Line Outlet	77
11.17	Blowout Preventer (BOP)	77
11.18	Well Test Equipment Areas	77
11.19	Rooms Used to Store Paint (Paint Lockers)	77
11.20	Battery Rooms	77
11.21	Reserved for Future Use	77
11.22	Helicopter Fuel Storage Areas	77
11.23	Classification of Adjacent Spaces	77
12	RECOMMENDATIONS FOR DETERMINING DEGREE AND EXTENT OF CLASSIFIED LOCATIONS AT DRILLING RIGS AND PRODUCTION FACILITIES ON FLOATING PRODUCTION UNITS	78
12.1	General	78
12.2	Floating Production Storage and Offloading Units (FPSOs)	78
12.3	Tension Leg Platforms (TLPs)	78
12.4	Spars, Caissons, and Similar Units	78

	Page
12.5 Classification of Adjacent Spaces	78
13 RESERVED FOR FUTURE USE	82
14 RECOMMENDATIONS FOR DETERMINING DEGREE AND EXTENT OF CLASSIFIED LOCATIONS AT PETROLEUM PIPELINE TRANSPORTATION FACILITIES	82
14.1 General	82
14.2 Use of Figures	82
14.3 Figures	82
APPENDIX A—SAMPLE CALCULATION TO ACHIEVE ADEQUATE VENTILATION OF AN ENCLOSED AREA BY NATURAL MEANS USING EQUATIONS 1 AND 2	97
APPENDIX B—CALCULATION OF MINIMUM AIR INTRODUCTION RATE TO ACHIEVE ADEQUATE VENTILATION USING FUGITIVE EMISSIONS	99
APPENDIX C—DEVELOPMENT OF VENTILATION CRITERIA	101
APPENDIX D—INFORMATIVE ANNEX—AN ALTERNATE METHOD FOR AREA CLASSIFICATION	103
APPENDIX E—PROCEDURE FOR CLASSIFYING LOCATIONS	111
APPENDIX F—PREFERRED SYMBOLS FOR DENOTING CLASS I, DIVISION 1 AND DIVISION 2 HAZARDOUS (CLASSIFIED) LOCATIONS	113

Figures

1 Increase in Flow Caused by Excess of One Opening Over Another	13
2 Adequately Ventilated Nonenclosed Area Adjacent to a Classified Area	14
3 Enclosed Area Adjacent to a Classified Area	14
4 Enclosed Area Adjacent to a Classified Area	14
5 Enclosed Area Adjacent to a Classified Area	14
6 Fixed Roof Flammable Liquid Storage Tank in a Nonenclosed Adequately Ventilated Area	18
7 Open Top Floating Roof Flammable Liquid Storage Tank in a Nonenclosed Adequately Ventilated Area	19
8 Combustible Liquid Storage Tank in a Nonenclosed Adequately Ventilated Area	20
9 Tank Car or Tank Truck Loading and Unloading Via Closed System. Product Transfer Through Dome Only	21
10 Tank Car or Tank Truck Loading and Unloading Via Closed System. Product Transfer Through Dome Only	22
11 Tank Car or Tank Truck Loading and Unloading Via Closed System. Product Transfer Through Bottom Only	23
12 Tank Car or Tank Truck Loading And Unloading Via Open System. Product Transfer Through Top Or Bottom	24
13 Tank Car or Tank Truck Loading and Unloading Via Closed System. Product Transfer Through Bottom Only	25
14 Process Equipment Vent in a Nonenclosed Adequately Ventilated Area	26
15 Instrument or Control Device Vent in a Nonenclosed Adequately Ventilated Area	26
16 Atmospheric Vent From a Division 1 Area	26
17 Atmospheric Vent From a Division 2 Area	27
18 Relief Valve in a Nonenclosed Adequately Ventilated Area	27
19 Marine Terminal Handling Flammable Liquids	28

	Page
20 Adequately Ventilated Process Location With Heavier-Than-Air Gas or Vapor Source Located Near Grade	32
21 Adequately Ventilated Process Location With Heavier-Than-Air Gas or Vapor Source Located Above Grade	32
22 Inadequately Ventilated Process Location With Heavier-Than-Air Gas or Vapor Source	33
23 Adequately Ventilated Compressor Shelter With Lighter-Than-Air Gas or Vapor Source	34
24 Adequately Ventilated Process Location With Lighter-Than-Air Gas or Vapor Source	34
25 Inadequately Ventilated Compressor Shelter With Lighter-Than-Air Gas or Vapor Source	5
26 Inadequately Ventilated Process Location With Lighter-Than-Air Gas or Vapor Source	35
27 Separators, Dissolved Air Flotation (DAF) Units, and Biological Oxidation (BIOX) Units	36
28 Mechanical Draft Cooling Tower Handling Process Cooling Water	37
29 Drilling Rig, Adequate Ventilation in Substructure, and Derrick is Not Enclosed, But is Equipped With a Windbreak, Open Top, and Open V-Door.	39
30 Drilling Rig, Adequate Ventilation in Enclosed Derrick (Open Top), and Inadequately Ventilated Substructure	40
31 Platform Drilling Rig, Adequately Ventilated in Substructure and Inside Derrick, Several Producing Wells Beneath in an Adequately Ventilated Area	41
32 Platform Drilling Rig, Adequate Ventilation in Substructure and Inside Derrick, Several Producing Wells Beneath in an Inadequately Ventilated Location	42
33 Mud Tank in a Nonenclosed Adequately Ventilated Area	43
34 Mud Tank in an Inadequately Ventilated Area	43
35 Shale Shaker in a Nonenclosed Adequately Ventilated Area	44
36 Desander or Desilter in a Nonenclosed Adequately Ventilated Area	44
37 Desander or Desilter in an Adequately Ventilated Enclosed Area	44
38 Degasser Vent in Nonenclosed Adequately Ventilated Area	45
39 Flowing Well in a Nonenclosed Adequately Ventilated Area and Without a Cellar or Below Grade Sump	45
40 Flowing Well in a Nonenclosed Adequately Ventilated Area With an Inadequately Ventilated Cellar or Below Grade Sump.	46
41 Flowing Well in an Inadequately Ventilated Enclosed Area	46
42 Nonenclosed Adequately Ventilated Well on Which Wireline Work is Being Performed	47
43 Nonenclosed Beam Pumping Well in an Adequately Ventilated Area Without a Cellar.	47
44 Nonenclosed Beam Pumping Well in an Adequately Ventilated Area With an Inadequately Ventilated Cellar	47
45 Electric Submersible Pumping Well in a Nonenclosed Adequately Ventilated Area Without a Cellar	48
46 Electric Submersible Pumping Well in a Nonenclosed Adequately Ventilated Area With an Inadequately Ventilated Cellar	48
47 Junction Box in a Nonenclosed Adequately Ventilated Area Connected to an Electric Submersible Pump.	48
48 Hydrocarbon Pressure Vessel or Protected Fired Vessel in a Nonenclosed Adequately Ventilated Area	50

49	Ball or Pig Launching or Receiving Installation in a Nonenclosed Adequately Ventilated Area	50
50	Flammable Gas-Blanketed and Produced Water-handling Equipment in a Nonenclosed Adequately Ventilated Area.	51
51	Compressor or Pump in an Adequately Ventilated Nonenclosed Area	52
52	Compressor or Pump in an Adequately Ventilated Nonenclosed Area	52
53	Compressor or Pump in an Adequately Ventilated Enclosed Area	53
54	Compressor or Pump in an Inadequately Ventilated Enclosed Area	54
55	Flammable Gas-Operated Instruments in an Adequately Ventilated Enclosed Area With All Devices Vented to the Outside.	55
56	Flammable Gas Operated Instruments in an Inadequately Ventilated Enclosed Area	55
57	Open Sump in Nonenclosed Adequately Ventilated Area	55
58	Type 1 Open Drain System	56
59	Type 2 Open Drain System	56
60	Type 3 Open Drain System in Nonenclosed Area	56
61	Type 3 Drain System in Enclosed Area	57
62	Type 4 Open Drain System in Nonenclosed Area	57
63	Type 4 Open Drain System in Enclosed Area	58
64	Control Panel With Flammable Gas Vented to the Inside of the Enclosure.	59
65	Inadequately Ventilated Control Panel With Instruments Inside	59
66	Adequately Ventilated Control Panel With Instruments Inside	60
67	Drilling Rig Open Derrick	64
68	Drilling Rig Semi-Enclosed Derrick.	65
69	Drilling Rig Derrick Fully Enclosed (Open Top).	66
70	Drilling Rig Open Substructure and Semi-Enclosed Derrick	67
71	Drilling Rig With Total Containment Substructure and Semi-Enclosed Derrick	68
72	Drilling Rig Semi-Enclosed Substructure and Semi-Enclosed Derrick	69
73	Drilling Rig Enclosed Moonpool and Semi-Enclosed Derrick	70
74	Mud System Processing Equipment in Adequately Ventilated Enclosed Spaces	71
75	Mud System Processing Equipment in Open Spaces.	72
76	Mud Tanks in Open Areas.	73
77	Open Top Mud Tanks in Enclosed or Semi-Enclosed Locations With Adequate Ventilation	73
78	Closed Top Mud Tanks in Enclosed or Semi-Enclosed Locations With Adequate Ventilation	74
79	Open Mud Trough in Open Space Before Degasser	74
80	Open Mud Trough in Enclosed Space With Adequate Ventilation Before Degasser	74
81	Open Mud Trough in Enclosed Space With Adequate Ventilation Downstream of Degasser	74
82	Open Mud Trough in Open Space Downstream of Degasser	75
83	Shale Shaker in Enclosed or Semi-Enclosed Space with Adequate Ventilation	75
84	Shale Shaker in Open Area With Adequate Ventilation	75
85	Desander or Desilter In Enclosed or Semi-Enclosed Space With Adequate Ventilation	76
86	Desander or Desilter in Open Area.	76
87	Discharges of Ventilation Vents and Equipment Vents Originating in Division 1 Areas	76

	Page
88 Ventilation Vents Originating in Division 2 Areas	76
89 Diverter Line Outlet	77
90 Typical Floating Production Storage and Offloading Unit (FPSO)	79
91 Typical Tension Leg Platform (TLP)	80
92 Typical Spar, Caisson, or Similar Unit	81
93 Outdoors—Pump or Compressor Handling Flammable Liquids or Highly Volatile Liquids	83
94 Adequately Ventilated Building—Pump or Compressor Handling Flammable Liquids or Highly Volatile Liquids	84
95 Inadequately Ventilated Building Pump or Compressor Handling Flammable Liquids or Highly Volatile Liquids)	85
96 Outdoors—Piping With Valves, Screwed Fittings, Flanges or Similar Accessories Handling Flammable Liquids or Highly Volatile Liquids. Also Covers Sampling Systems, Instrumentation and Instrument-Sized Pumps.	86
97 Adequately Ventilated Building—Piping With Valves, Screwed Fittings, Flanges or Similar Accessories Handling Flammable Liquids or Highly Volatile Liquids. Also Covers Sampling Systems, Instrumentation and Instrument-Sized Pumps.	87
98 Inadequately Ventilated Building—Piping With Valves, Screwed Fittings, Flanges or Similar Accessories Handling Flammable Liquids or Highly Volatile Liquids. Also Covers Sampling Systems, Instrumentation and Instrument-Sized Pumps.	88
99 Elevated Storage Tank or Pressure Vessel.	89
100 Below Grade Sump Tank And Oil-Water Separator.	90
101 Below Grade Vault—Piping With Valves, Screwed Fittings, Flanges or Similar Accessories Handling Flammable Liquids or Highly Volatile Liquids. Also Covers Sampling Systems, Instrumentation and Instrument-Sized Pumps.	91
102 Above Grade Source With Closure.	92
103 Storage Cavern	93
104 Outdoors—Compressor or Other Source Handling Lighter-Than-Air Flammable Gas	94
105 Adequately Ventilated Building—Compressor or Other Source Handling Lighter-Than-Air Flammable Gas	95
106 Inadequately Ventilated Building—Compressor or Other Source Handling Lighter-Than-Air Flammable Gas	96
D-1 Vapor Pressure—Temperature Volatility Chart	105
D-2 Volatility—Release Rate Matrix for Determining Hazard Radius.	106
D-3 Adequately Ventilated Process Area With Heavier-Than-Air Gas or Vapor Source Located Near or Above Grade	107
D-4 Hazard Radius for Point Sources Containing Lighter-Than-Air Gases or Vapors	109
F-1 Preferred Symbols for Denoting Class I, Hazardous (Classified) Locations. . . .	113
 Tables	
1A Basis of Grouping of Class I Gases and Vapors (SI Units)	8
1B Basis of Grouping of Class I Gases and Vapors (U.S. Units).	9
D-1 Pumps Handling Heavier-Than-Air Gases or Vapors Located In Non-Enclosed Adequately Ventilated Process Areas	108
D-2 Determining Hazard Radius for Sources With Restrictions for Heavier-Than-Air Gases or Vapors.	108

	Page
D-3 Atmospheric Vents and Drains Handling Heavier-Than-Air Gases or Vapors	108
D-4 Flanges and Valves Containing Heavier-Than-Air Gases or Vapors With a Higher Probability of Leakage	108

Recommended Practice for Classification of Locations for Electrical Installations at Petroleum Facilities Classified as Class I, Division 1 and Division 2

1 Scope

1.1 PURPOSE

1.1.1 The purpose of this recommended practice is to provide guidelines for classifying locations Class I, Division 1 and Class I, Division 2 at petroleum facilities for the selection and installation of electrical equipment. Basic definitions given in the 1996 edition of NFPA 70, the National Electrical Code (NEC), have been followed in developing this recommended practice. This publication is only a guide and requires the application of sound engineering judgment.

Note: Recommendations for determining the degree and extent of locations classified Class I, Zone 0, Zone 1, and Zone 2 are addressed in API RP 505, Recommended Practice for Classification of Locations for Electrical Installations at Petroleum Facilities Classified as Class I, Zone 0, Zone 1, and Zone 2.

1.1.2 Electrical installations in areas where flammable liquids, gases, or vapors are produced, processed, stored or otherwise handled can be suitably designed if the locations of potential sources of release and accumulation are clearly defined. Once a location has been classified, requirements for electrical equipment and associated wiring should be determined from applicable publications. Applicable publications may include NFPA 70 (NEC) or API RP 14F. Reference Section 2 for publications for other possible applications.

1.2 SCOPE

1.2.1 This document applies to the classification of locations for both temporarily and permanently installed electrical equipment. It is intended to be applied where there may be a risk of ignition due to the presence of flammable gas or vapor, mixed with air, under normal atmospheric conditions. Normal atmospheric conditions are defined as conditions that vary above and below reference levels of 101.3 kPa (14.7 psia) and 20°C (68°F) provided that the variations have a negligible effect on the explosion properties of the flammable materials.

The following items are beyond the scope of this document:

- a. Piping systems used for odorized natural gas used as fuel for cooking, heating, air conditioning, laundry and similar appliances;
- b. catastrophes such as well blowouts or process vessel ruptures. Such extreme conditions require emergency measures at the time of occurrence;
- c. the suitability of locations for the placement of non-electrical equipment; and

d. classification of locations containing combustible dust, ignitable fibers, or flyings.

1.2.2 Recommendations for determining the degree and extent of classified locations for specific examples of situations commonly encountered in petroleum facilities are given in Sections 8 through 14. While it is important for area classifications at refineries, production and drilling facilities, and pipeline facilities to agree to some extent, there are differences in production, drilling, transportation and refining facilities. Some differences include the process conditions, types and quantities of products handled, the physical size of typical facilities, and varying housing and sheltering practices.

1.2.3 Section 8 includes applications that are common to several of the facility types described in Sections 9 through 14.

1.2.4 Section 9 is applicable to locations in which flammable petroleum gases and vapors and volatile flammable liquids are processed, stored, loaded, unloaded, or otherwise handled in petroleum refineries.

1.2.5 Section 10 is applicable to locations surrounding oil and gas drilling and workover rigs and production facilities on land and on marine fixed (bottom-founded, non-floating) platforms where flammable petroleum gas and volatile liquids are produced, processed (for example, compressed), stored, transferred (for example, pumped), or otherwise handled prior to entering the transportation facilities.

1.2.6 Section 11 is applicable to locations on Mobile Offshore Drilling Units (MODUs).

1.2.7 Section 12 is applicable to locations surrounding oil and gas drilling and workover rigs and production facilities on floating production units (FPU) such as, but not limited to, tension leg platforms (TLPs), floating production systems (FPSs), floating production systems with off-loading (FPSOs), single anchor leg mooring buoys (SALMs), caisson structures, spars, and other floating structures where flammable petroleum gas and volatile liquids are produced, processed (for example, compressed), stored, transferred (for example, pumped) or otherwise handled prior to entering the transportation facilities.

1.2.8 Section 13 is reserved for future use.

1.2.9 Section 14 is applicable to onshore and offshore facilities handling the delivery of flammable or combustible petroleum liquids or flammable gases. Pipeline facilities may include pump and compressor stations, storage facilities, manifold areas, valve sites and pipeline right-of-way areas.